

IES INDOOR REPORT
PHOTOMETRIC FILENAME : 707-Z2-48-Z-359-B3GB-BL-LO.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002
 [TEST] L072413211 (SOURCE REPORT BASED FOR REFERENCE)
 [TESTLAB] REPORT BASED ON DATA FROM NVLAP ACCREDITED LAB
 [ISSUE DATE] 8/27/2024
 [MANUFAC] Vode Lighting LLC
 [LUMCAT] 707-Z2-48-Z-359-B3GB-BL-LO
 [LUMINAIRE] ZipTwo LED, 48", 3500K, 90 CRI, Zipper Board, 120° Graphite Baffle, Black Finish, Low Output
 [MORE] 3535 Low Glare, Low Output, Black
 [TEST PROCEDURE] IESNA:LM-79-19

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	253
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	19
Total Luminaire Watts	13.2
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	0.76
Spacing Criterion (90-270)	1.26
Spacing Criterion (Diagonal)	1.04
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	4.00 ft
Luminous Width (90-270)	0.13 ft
Luminous Height	0.13 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	440	809	866
55	145	185	293
65	58	40	92
75	60	18	21
85	0	0	0

**IES INDOOR REPORT
 PHOTOMETRIC FILENAME : 707-Z2-48-Z-359-B3GB-BL-LO.IES**

CANDELA TABULATION

	<u>0.0</u>	<u>22.5</u>	<u>45.0</u>	<u>67.5</u>	<u>90.0</u>	<u>112.5</u>	<u>135.0</u>	<u>157.5</u>	<u>180.0</u>
0	210.42	210.42	210.42	210.42	210.42	210.42	210.42	210.42	210.42
5	199.08	203.70	206.22	210.84	213.36	210.84	206.22	199.08	201.18
10	178.08	187.74	196.56	211.26	217.56	208.74	196.98	183.54	182.28
15	155.82	168.84	183.96	207.48	219.24	204.12	185.22	161.70	158.34
20	131.04	147.00	168.42	201.60	219.66	196.98	167.58	140.28	133.98
25	105.42	122.22	150.78	192.36	214.20	185.22	149.52	115.08	107.94
30	79.38	98.28	128.52	173.04	188.16	159.60	128.10	90.72	82.32
35	57.12	75.18	104.16	138.60	145.74	121.80	103.32	66.78	59.22
40	36.54	50.40	76.02	98.28	99.12	83.16	74.34	43.68	36.54
45	15.54	28.98	47.88	62.58	59.22	49.14	46.20	22.68	16.80
50	5.46	10.92	25.20	35.70	34.02	27.30	24.36	7.56	6.30
55	4.20	5.04	10.50	19.32	19.74	14.70	9.24	4.20	4.20
60	2.10	2.94	3.78	9.66	11.34	7.56	3.78	2.10	2.10
65	1.26	1.68	2.10	5.04	5.88	3.36	2.10	1.26	1.26
70	0.84	0.84	0.84	2.10	2.52	1.68	0.84	0.84	0.84
75	0.84	0.42	0.84	0.84	1.26	0.84	0.42	0.00	0.84
80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : 707-Z2-48-Z-359-B3GB-BL-LO.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	71.68	N.A.	28.30
0-30	142.02	N.A.	56.20
0-40	204.96	N.A.	81.00
0-60	249.16	N.A.	98.50
0-80	252.91	N.A.	100.00
0-90	252.91	N.A.	100.00
10-90	233.48	N.A.	92.30
20-40	133.28	N.A.	52.70
20-50	166.70	N.A.	65.90
40-70	47.25	N.A.	18.70
60-80	3.76	N.A.	1.50
70-80	0.70	N.A.	0.30
80-90	0.00	N.A.	0.00
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	252.91	N.A.	100.00

Total Luminaire Efficiency = N.A.%

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	19.44
10-20	52.25
20-30	70.34
30-40	62.94
40-50	33.43
50-60	10.77
60-70	3.05
70-80	0.70
80-90	0.00
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : 707-Z2-48-Z-359-B3GB-BL-LO.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0	
	RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100
1	113	110	107	104	110	108	105	103	103	101	100	100	98	97	96	95	94	92	92
2	106	101	96	92	104	99	95	91	96	92	89	93	90	87	90	88	86	84	84
3	100	93	87	83	98	91	86	82	89	84	81	86	82	79	84	81	78	76	76
4	94	86	79	75	92	84	79	74	82	77	73	80	76	72	78	74	71	70	70
5	88	79	72	68	87	78	72	67	76	71	67	74	70	66	73	69	65	64	64
6	83	73	67	62	82	72	66	62	71	65	61	69	64	61	68	64	60	59	59
7	78	68	61	57	77	67	61	56	66	60	56	65	60	56	64	59	56	54	54
8	74	63	57	52	73	63	57	52	62	56	52	61	55	52	60	55	51	50	50
9	70	59	53	48	69	59	53	48	58	52	48	57	52	48	56	51	48	46	46
10	66	56	49	45	65	55	49	45	54	49	45	53	48	45	53	48	44	43	43

IES INDOOR REPORT
PHOTOMETRIC FILENAME : 707-Z2-48-Z-359-B3GB-BL-LO.IES


UGR TABLE - CORRECTED

Reflectances										
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	0.0	0.0	0.0	0.0	0.0	4.9	6.0	5.2	6.3	6.6
	3H	0.0	0.0	0.0	0.0	0.0	5.0	6.0	5.4	6.4	6.7
	4H	0.0	0.0	0.0	0.0	0.0	5.0	5.9	5.4	6.3	6.7
	6H	0.0	0.0	0.0	0.0	0.0	4.9	5.8	5.3	6.1	6.5
	8H	0.0	0.0	0.0	0.0	0.0	4.9	5.7	5.3	6.1	6.5
	12H	0.0	0.0	0.0	0.0	0.0	4.8	5.6	5.3	6.0	6.4
4H	2H	0.0	0.0	0.0	0.0	0.0	4.6	5.6	5.0	5.9	6.3
	3H	0.0	0.0	0.0	0.0	0.0	4.8	5.6	5.2	6.0	6.4
	4H	0.0	0.0	0.0	0.0	0.0	4.8	5.5	5.2	5.9	6.3
	6H	0.0	0.0	0.0	0.0	0.0	4.7	5.3	5.2	5.7	6.2
	8H	0.0	0.0	0.0	0.0	0.0	4.6	5.2	5.1	5.6	6.1
	12H	0.0	0.0	0.0	0.0	0.0	4.6	5.0	5.1	5.5	6.0
8H	4H	0.0	0.0	0.0	0.0	0.0	4.6	5.2	5.1	5.6	6.1
	6H	0.0	0.0	0.0	0.0	0.0	4.5	4.9	5.0	5.4	5.9
	8H	0.0	0.0	0.0	0.0	0.0	4.4	4.8	5.0	5.4	5.8
	12H	0.0	0.0	0.0	0.0	0.0	4.4	4.7	4.9	5.2	5.8
12H	4H	0.0	0.0	0.0	0.0	0.0	4.6	5.0	5.1	5.5	6.0
	6H	0.0	0.0	0.0	0.0	0.0	4.4	4.8	5.0	5.3	5.9
	8H	0.0	0.0	0.0	0.0	0.0	4.4	4.7	4.9	5.2	5.8

Maximum UGR = 6.7

POLAR GRAPH

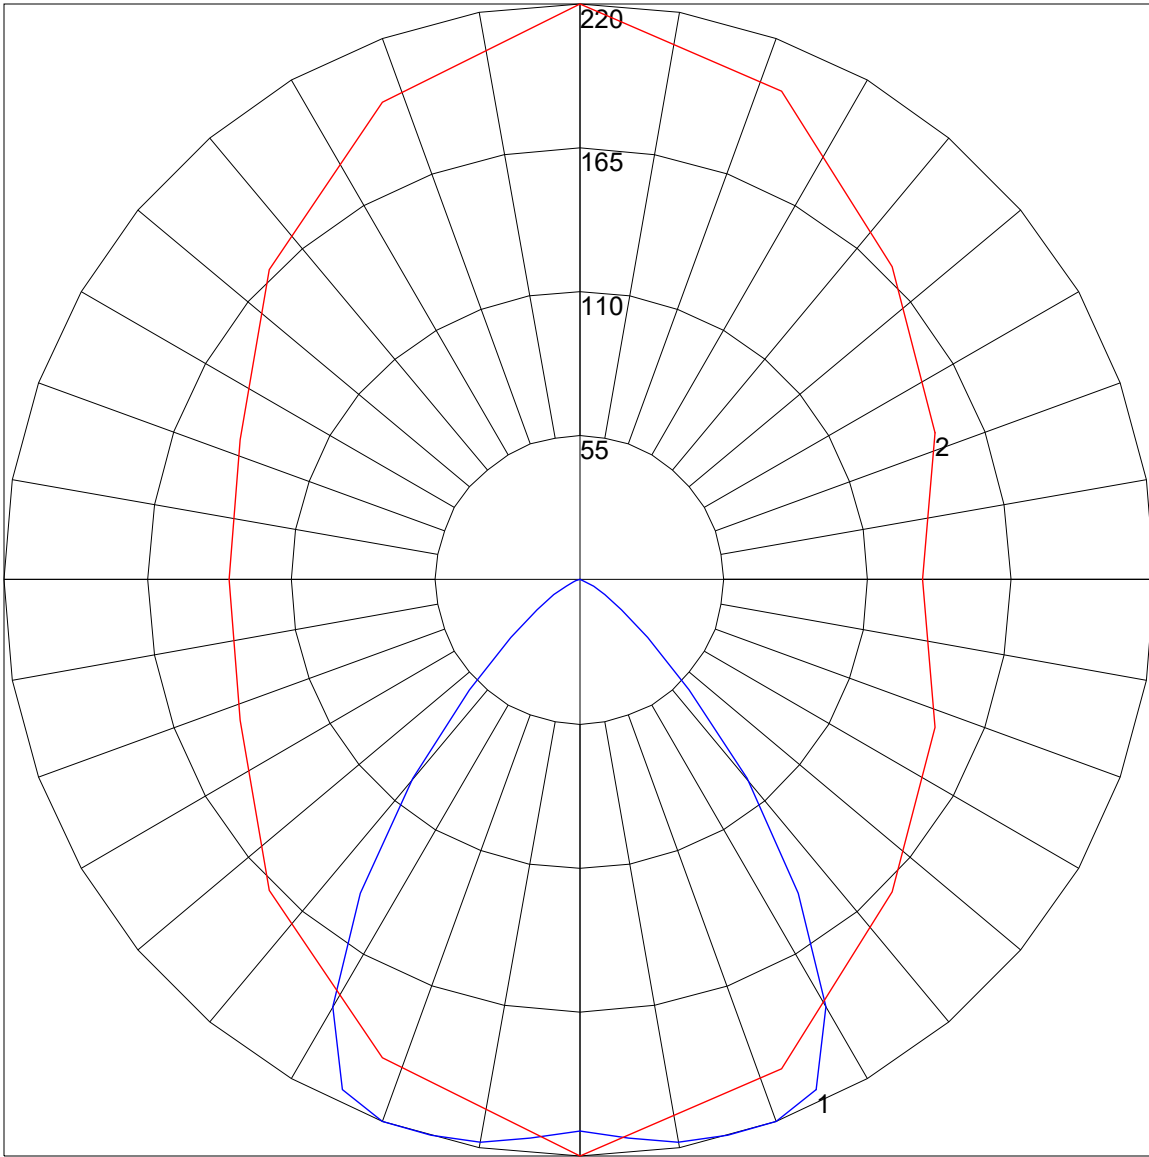

Maximum Candela = 219.66 Located At Horizontal Angle = 90, Vertical Angle = 20
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (20) (Through Max. Cd.)