

**IES Report**

**WingRail® | 107 | Diffuse | 90 CRI | SO**

107-WG-XX-4-48-XX-XX-XX-XX-X-X-Z-SO-359-D1-X-XX-X

	2700K	3000K	3500K	4000K
Efficacy - Lumens per Watt	78	81	83	83
Total Lumens, 4' rail length (1219mm)	1870	1929	1968	1988
Lumens per foot (305mm)	467	482	492	497
Input Power (W), 4' rail length (1219mm)	24.0	24.0	24.0	24.0
Watts per foot (305mm)	6.0	6.0	6.0	6.0
CRI	94	94	94	94

Due to the large number of options in Vode's product offering, most Vode IES reports are factored reports prepared from source reports. Source reports are the IES test reports prepared for Vode by an NVLAP accredited photometric test laboratory. Factored reports are based on data from the Vode source reports.

If the data above is in black, it is directly from a Vode source report. If it is in grey, it is factored from Vode source reports. Reference details on Vode source reports can be found on the [IES File Finder](#) page on [vode.com](#).



8165 E Kaiser Blvd.  
 Anaheim, CA 92808  
 www.lightlaboratory.com

Report No: L121911521



**Report No:** L121911521

**Issue Date:** 1/6/2020

**Report Prepared For:** Vode Lighting  
 21684 8th Street East, Suite 700, Sonoma, CA 95476

**Model Number:** 107-WG-48-Z-SO-359-D1-AL

**Test:** Photometric/Colorimetric/Electrical Test

**Standards Used:** Appropriate part or all test guidelines were used for test performed:  
*IESNA LM79: 2008* Approved Methods for Electrical and Photometric Measurements of Solid-State Lighting Products  
*ANSI NEMA ANSLG C78.377: 2008* Specification of the Chromaticity of Solid State Lighting Products  
*ANSI C82.77:2002:* Harmonic Emission Limits-Related Quality Requirements for Lighting Equipment

**Description of Sample:** Client submitted the sample. Received in working and undamaged condition. No modifications were necessary.

**Special Test Condition:** Fixture is tested with no special conditions.

**Sample Arrival Date:** 12/16/19

**Date of Tests:** 12/28/19 - 1/6/20

**Seasoning of Sample:** No seasoning was performed in accordance with IESNA LM-79.

**Equipment List**

Equipment Used	Model No	Stock No	Calibration Due Date
Chroma Programmable AC Source	61604	PS-AC02	--
Yokogawa Digital Power Meter	WT210	MT-EL06-S4	1/9/21
BK PRECISION	1747	PS-DC04	1/10/21
Fluke Digital Thermometer	52K/J	MT-TP05	1/10/21
LLI Type C Goniophotometer System	RMG-C-MKII	CD-LL04-GC	--
LLI 2M Sphere	2MR97	CD-SN03-S2	--
LLI Spectroradiometer	SPR-3000	MT-SC01-S2	Before Use

**General Information**

<b>Manufacturer:</b>	Vode Lighting
<b>Model Number:</b>	107-WG-48-Z-SO-359-D1-AL
<b>Driver Model Number:</b>	MEAN WELL HLG-40H-36A

**Test Summary**

<b>Total Lumens:</b>	1968.05
<b>Efficacy:</b>	82.06
<b>Color Redering Index:</b>	94.1
<b>Correlated Color Temperature:</b>	3353
<b>Input Voltage (VAC/60Hz):</b>	120.01
<b>Input Current (Amp):</b>	0.2012
<b>Input Power (W):</b>	23.98
<b>Input Power Factor:</b>	0.9933
<b>Current ATHD (%):</b>	8.6%

**Test Condition**

<b>Ambient Temperature (°C):</b>	25.0
<b>Stabilization Time (Hours):</b>	0:45
<b>Total Operating Time (Hours):</b>	1:40


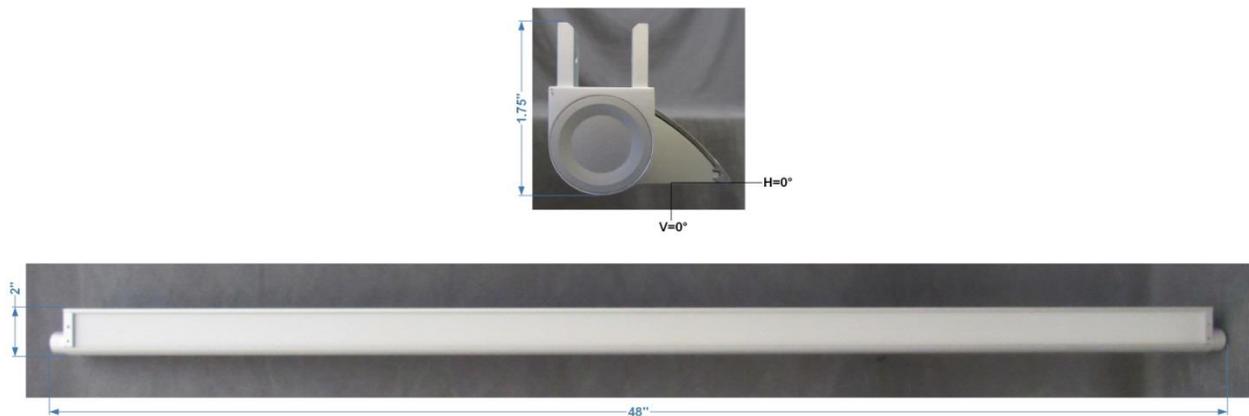


FIG. 1 LUMINAIRE

**Colorimetry Test Results**

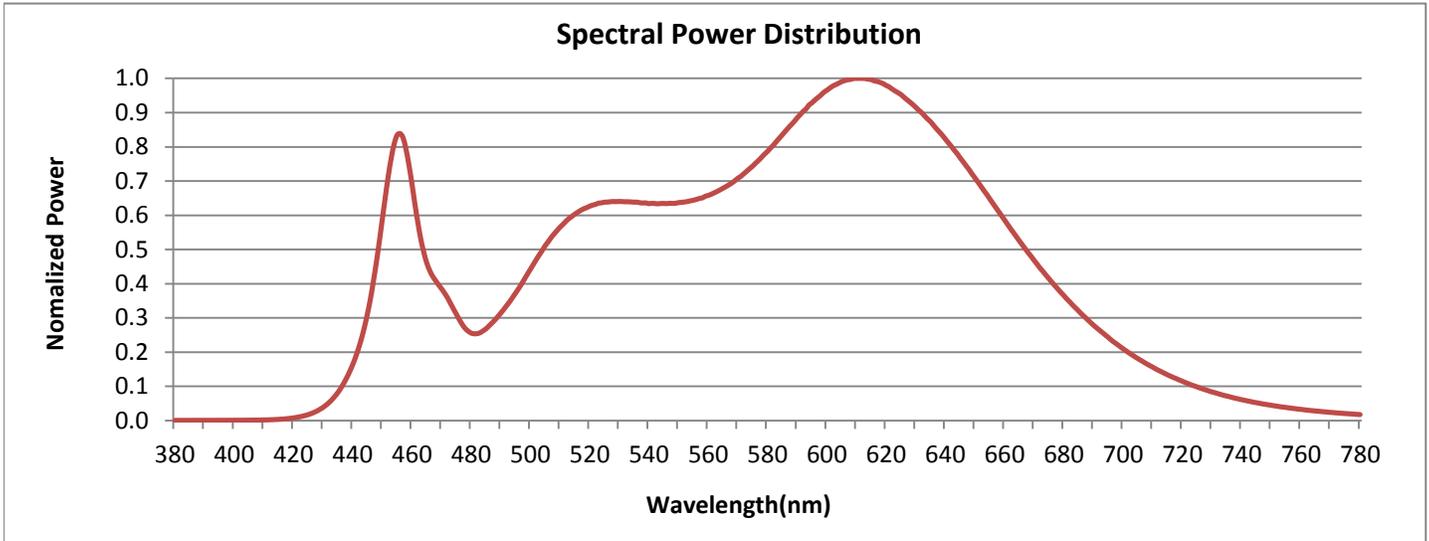


**CRI & CCT**

x	0.4132
y	0.3932
u'	0.2398
v'	0.5135
CRI	94.10
CCT	3353
Duv	-0.00057

**R Values**

R1	96.00
R2	98.88
R3	98.13
R4	96.32
R5	96.09
R6	95.93
R7	90.49
R8	80.82
R9	57.04
R10	97.03
R11	98.03
R12	77.48
R13	97.64
R14	99.62
R15	90.13

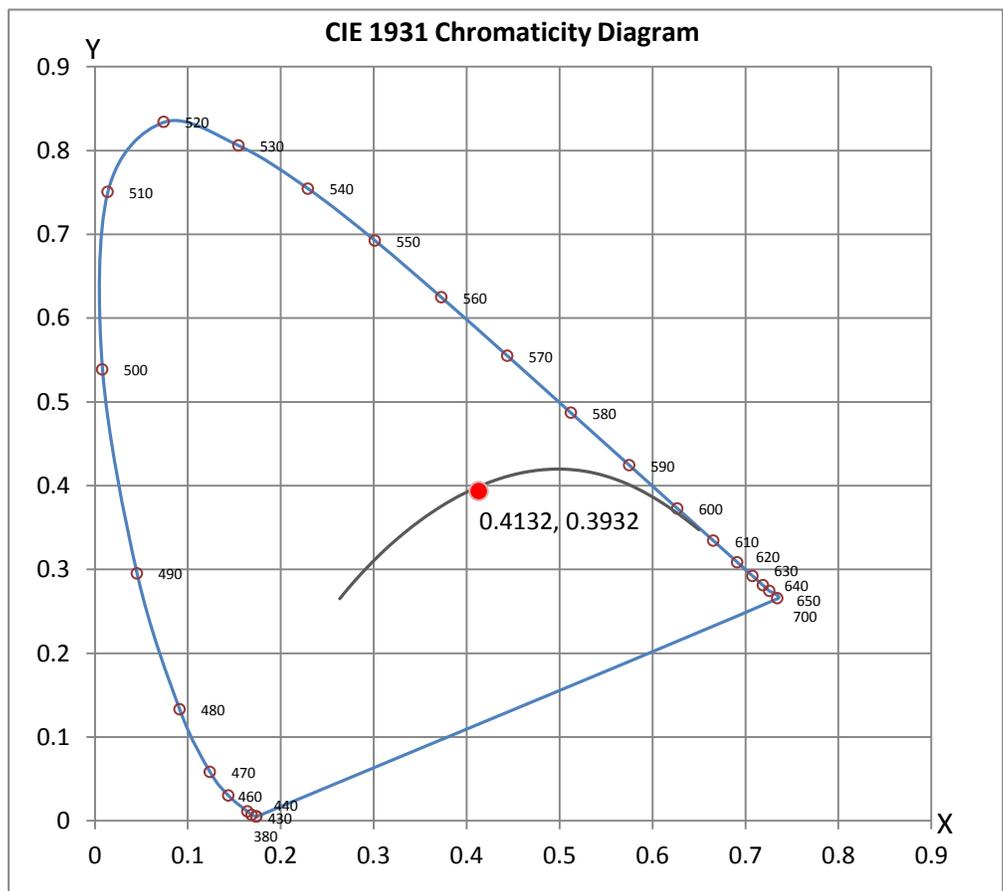

## Test Methods

### Photometric Measurements - Goniophotometer

A Custom Light Laboratory Type C Rotating Mirror Goniophotometer was used to measure candelas(intensity) at each angle of distribution as defined by IESNA for the appropriate fixture type.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

### Spectral Measurements - Integrating Sphere

A Sensing Spectroradiometer SPR-3000, in conjunction with Light Laboratory 2 meter integrating sphere was used to measure chromaticity coordinates, correlated color temperature(CCT) and the color rendering index(CRI) for each sample.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

### Disclaimers:

This report must not be used by the customer to claim product certification, approval or endorsement by NVLAP, NIST or any agency of Federal Government.

Report Prepared by : Keyur Patel

Test Report Reviewed by:



Steve Kang  
Quality Assurance

*\*Attached are photometric data reports. Total number of pages: 9*



8165 E. Kaiser Blvd. Anaheim, CA 92808  
www.lightlaboratory.com

# Photometric Test Report

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L121911521.IES**

**DESCRIPTION INFORMATION (From Photometric File)**

IESNA:LM-63-2002  
[TEST] L121911521  
[TESTLAB] LIGHT LABORATORY, INC. (www.lightlaboratory.com)  
[ISSUEDATE] 1/6/2020  
[MANUFAC] Vode Lighting  
[LUMCAT] 107-WG-48-Z-SO-359-D1-AL  
[LUMINAIRE] WingRail LED, 48", 3500K, 90 CRI, zipper board, diffuse lens,  
[MORE] standard output, clear anodized finish  
[BALLASTCAT] MEAN WELL HLG-40H-36A  
[OTHER] INDICATING THE CANDELA VALUES ARE ABSOLUTE AND  
[MORE] SHOULD NOT BE FACTORED FOR DIFFERENT LAMP RATINGS.  
[INPUT] 120.01VAC, 23.98W  
[TEST PROCEDURE] IESNA:LM-79-08

**CHARACTERISTICS**

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1968
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	82
Total Luminaire Watts	23.98
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.26
Spacing Criterion (90-270)	1.26
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	0.13 ft
Luminous Width (90-270)	3.85 ft
Luminous Height	0.00 ft

**LUMINANCE DATA (cd/sq.m)**

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	13963	13910	13826
55	13414	13361	13238
65	12534	12532	12303
75	10925	11096	10626
85	6964	8007	7480

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L121911521.IES**

**CANDELA TABULATION**

	<b>0</b>	<b>5</b>	<b>10</b>	<b>15</b>	<b>20</b>	<b>25</b>	<b>30</b>	<b>35</b>	<b>40</b>	<b>45</b>
<b>0</b>	687.23	687.23	687.23	687.23	687.23	687.23	687.23	687.23	687.23	687.23
<b>5</b>	685.43	685.14	685.26	685.22	685.14	685.18	685.18	685.22	685.18	685.26
<b>10</b>	676.71	676.63	676.63	676.80	676.71	676.80	676.80	676.67	676.75	676.67
<b>15</b>	662.04	662.08	661.96	661.92	662.13	661.88	661.79	661.83	661.54	661.58
<b>20</b>	641.17	641.09	641.17	641.21	641.05	641.00	640.71	640.67	640.50	640.46
<b>25</b>	614.77	614.72	614.72	614.60	614.47	614.31	614.10	613.89	613.84	613.59
<b>30</b>	583.00	583.00	582.83	582.75	582.62	582.37	582.24	581.95	581.74	581.40
<b>35</b>	545.95	546.03	545.90	545.86	545.65	545.53	545.28	545.07	544.73	544.48
<b>40</b>	504.96	505.08	504.83	504.66	504.45	504.24	503.99	503.83	503.45	503.41
<b>45</b>	459.52	459.52	459.40	459.27	459.15	458.85	458.64	458.43	458.06	457.76
<b>50</b>	410.65	410.53	410.36	410.28	410.11	409.98	409.77	409.48	409.10	408.77
<b>55</b>	358.10	358.14	358.01	357.93	357.80	357.72	357.59	357.38	357.13	356.67
<b>60</b>	303.44	303.36	303.49	303.40	303.40	303.40	303.23	303.19	302.94	302.69
<b>65</b>	246.53	246.53	246.44	246.57	246.69	246.82	246.90	246.90	246.86	246.49
<b>70</b>	188.77	188.69	188.77	188.86	189.07	189.40	189.61	189.74	189.82	189.78
<b>75</b>	131.60	131.56	131.69	131.94	132.15	132.36	132.78	133.11	133.41	133.66
<b>80</b>	77.45	77.50	77.71	77.91	78.33	78.71	79.13	79.63	80.09	80.64
<b>85</b>	28.25	28.33	28.54	28.84	29.26	29.80	30.39	31.10	31.73	32.48
<b>90</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

**Vert. Angles**      **Horizontal Angles**

	<b>50</b>	<b>55</b>	<b>60</b>	<b>65</b>	<b>70</b>	<b>75</b>	<b>80</b>	<b>85</b>	<b>90</b>
<b>0</b>	687.23	687.23	687.23	687.23	687.23	687.23	687.23	687.23	687.23
<b>5</b>	685.26	685.09	685.09	685.09	685.22	685.22	685.18	685.22	685.18
<b>10</b>	676.59	676.46	676.59	676.42	676.54	676.50	676.29	676.42	676.63
<b>15</b>	661.46	661.41	661.29	661.20	661.12	661.12	661.12	661.08	660.87
<b>20</b>	640.29	640.12	640.00	639.96	639.91	639.83	639.66	639.66	639.58
<b>25</b>	613.34	613.13	613.05	612.96	612.84	612.63	612.63	612.46	612.42
<b>30</b>	581.24	580.78	580.65	580.48	580.36	580.06	579.98	580.06	579.90
<b>35</b>	544.02	543.77	543.52	543.26	542.93	542.76	542.64	542.47	542.51
<b>40</b>	502.86	502.48	502.02	501.65	501.35	501.14	501.02	501.14	500.85
<b>45</b>	457.34	456.80	456.30	455.92	455.58	455.29	455.00	454.87	455.00
<b>50</b>	408.39	407.72	407.18	406.71	406.42	406.00	405.71	405.63	405.54
<b>55</b>	356.38	355.79	355.12	354.62	354.03	353.65	353.44	353.40	353.40
<b>60</b>	302.27	301.77	301.14	300.51	299.76	299.25	298.96	298.62	298.50
<b>65</b>	246.23	245.69	245.06	244.31	243.51	242.67	242.29	242.04	242.00
<b>70</b>	189.65	189.19	188.52	187.68	186.63	185.67	184.87	184.54	184.41
<b>75</b>	133.87	133.74	133.53	132.65	131.44	130.01	128.84	128.17	128.00
<b>80</b>	81.06	81.39	81.60	81.60	80.93	79.21	77.41	75.99	75.61
<b>85</b>	33.32	34.12	34.87	35.54	35.92	35.75	34.37	31.48	30.34
<b>90</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L121911521.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	251.80	N.A.	12.80
0-30	534.56	N.A.	27.20
0-40	875.09	N.A.	44.50
0-60	1546.17	N.A.	78.60
0-80	1929.1	N.A.	98.00
0-90	1968.05	N.A.	100.00
10-90	1902.93	N.A.	96.70
20-40	623.28	N.A.	31.70
20-50	976.06	N.A.	49.60
40-70	913.86	N.A.	46.40
60-80	382.94	N.A.	19.50
70-80	140.16	N.A.	7.10
80-90	38.95	N.A.	2.00
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	1968.05	N.A.	100.00

Total Luminaire Efficiency = N.A.%

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	65.12
10-20	186.68
20-30	282.76
30-40	340.52
40-50	352.77
50-60	318.31
60-70	242.78
70-80	140.16
80-90	38.95
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L121911521.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	99	96	106	102	98	94	97	94	91	93	91	88	90	88	86	83
2	99	90	83	78	96	88	82	77	85	80	75	82	77	73	79	75	72	69
3	90	79	71	64	87	78	70	64	75	68	63	72	66	62	69	65	61	58
4	82	70	61	55	80	69	61	54	66	59	53	64	58	53	62	56	52	50
5	76	63	54	47	73	62	53	47	59	52	46	57	51	46	56	50	45	43
6	70	56	47	41	68	55	47	41	54	46	40	52	45	40	50	44	40	38
7	65	51	42	36	63	50	42	36	49	41	36	47	40	35	46	40	35	33
8	60	47	38	32	59	46	38	32	45	37	32	43	37	32	42	36	31	30
9	56	43	34	29	55	42	34	29	41	34	29	40	33	29	39	33	28	27
10	53	39	31	26	51	39	31	26	38	31	26	37	30	26	36	30	26	24

POLAR GRAPH

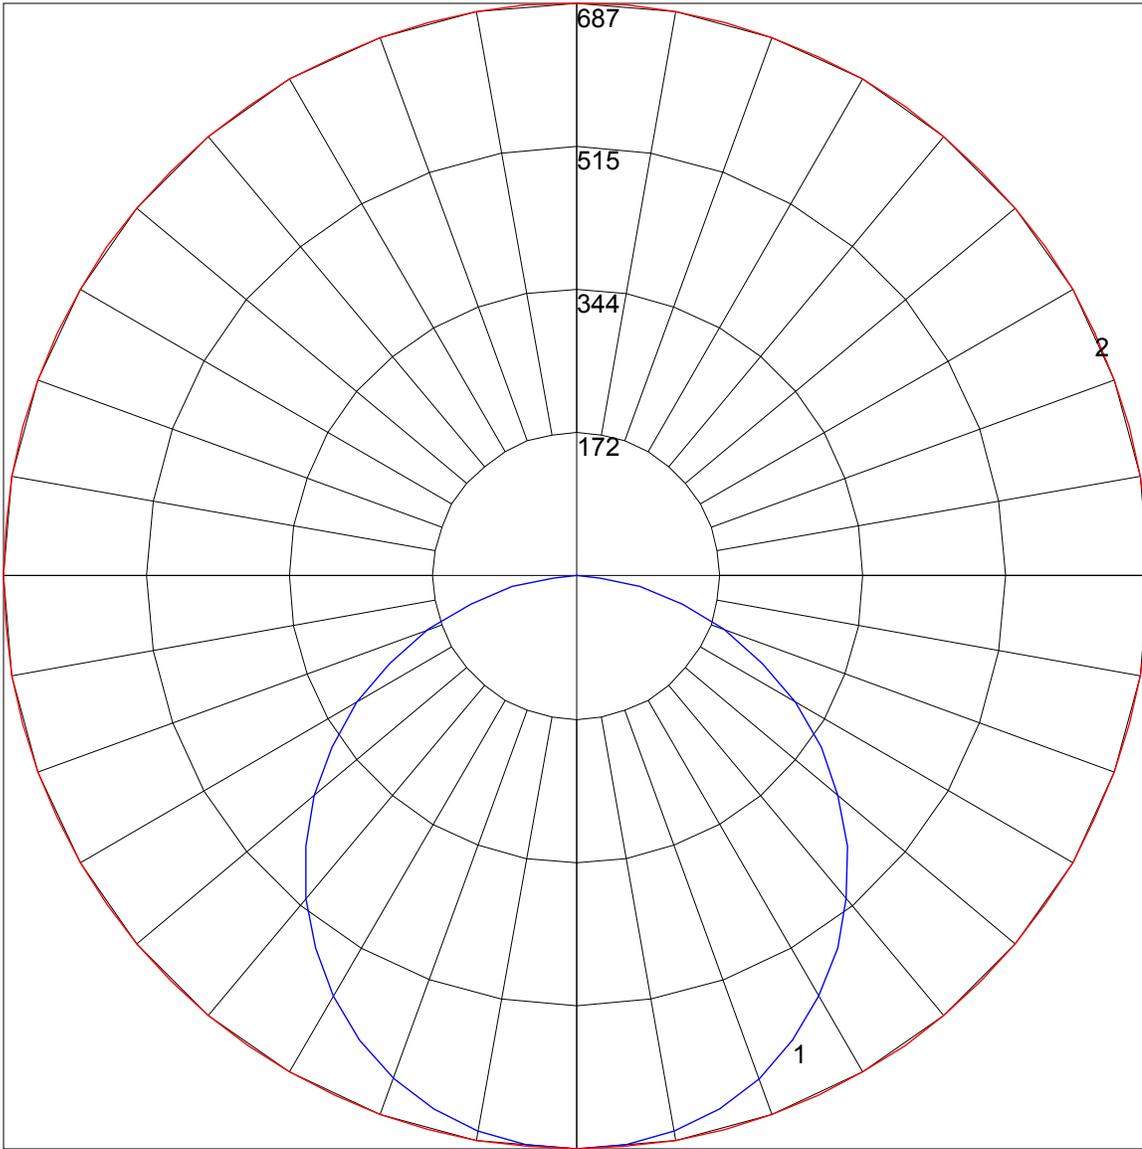

Maximum Candela = 687.23 Located At Horizontal Angle = 0, Vertical Angle = 0  
# 1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)